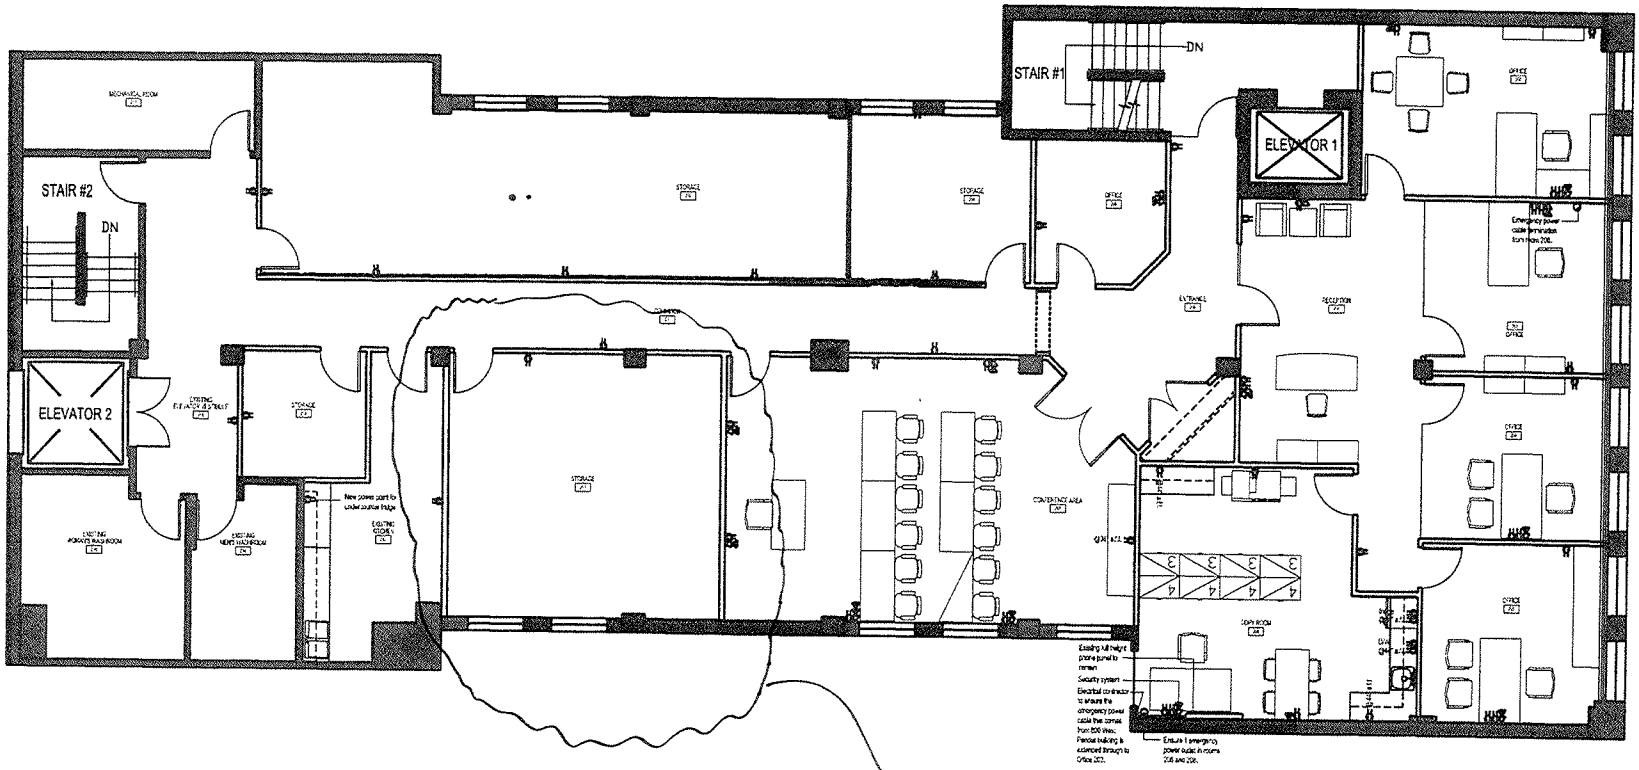

POWER, VOICE & DATA NOTES

2. All mechanical/electrical work to be design/build.
3. All work for this project shall comply with the latest edition of the British Columbia Electrical Codes and all other applicable codes as required by the authority and/or authorities having jurisdiction over this project.
4. Provide general purpose outlets as required by code
5. Contractor responsible for updating all electrical panels.
6. Contractor to confirm existing site conditions prior to commencing work.
7. All necessary conduit pipes for computer and telephone to be supplied by electrical contractor and must comply with all applicable codes.
8. All outlets to be mounted at 12" aff unless otherwise noted. All dimension are taken to the centre of the outlet above finished floor.
9. Floor slabs to be x-rayed and skins submitted for approval by structural engineer and/or Landlord before coring, cutting chipping or jack hammering may commence.
   All locations for thermostats must be verified with design consultant prior to installation. Thermostats to be located as discreetly as possible.
10. Electrical contractor to coordinate with tenant's telephone and computer consultant.
11. Electrical contractor will be responsible for coordination of all outlet locations with millwork suppliers, furniture and equipment manufacturers.
12. All outlets to be staggered to avoid sound transmission.
13. All existing outlets to be reused where possible. Remove all unused outlets above 12" aff

POWER, VOICE & DATA LEGEND

1. Electrical consultant to inventory existing outlets on site and reuse all outlets where possible. Provide blank face plates for all outlets not rewired. Confirm with designer if necessary.

⊕ New duplex electrical outlet. Install @ 12" aff unless otherwise specified.

▽ New telephone outlet. Install @ 12" aff unless otherwise specified.

▼ New data outlet. Install @ 12" aff unless otherwise specified.

▽▼ New cable data outlet. Install @ 12" aff unless otherwise specified.

○ New emergency power cable termination port. Install @ 12" aff unless otherwise specified.

PROJECT NOTES

1. Any remaining outlets in areas 200,201,202,203,204,205,206,208 installed higher than 12" to be relocated to 12" on centre.

#250
527 S.F. RENTABLE.
USABLE. APPROX 20FT. X 20FT.

ISSUED FOR CONSTRUCTION

Contractor must check and verify all dimensions and conditions on site and report any discrepancies to designer and/or engineer prior to proceeding with work

DO NOT SCALE DRAWINGS

All drawings, specifications and related documents are the copyright property of Arris Design. Reproduction of any of the aforementioned documents in whole or in part is not permitted without the written permission of Arris Design.

NORTH

PRODUCTION DRAWINGS BY:
ARRIS
502 – 134 Abbott Street
Vancouver, BC V6B 2K4
Phone: 604.408.4847
Fax: 866.849.0005
Email: info@arrisdesign.ca

REV	DESCRIPTION	DATE
3.	ISSUED FOR CONSTRUCTION	17/10/08
2.	ISSUED FOR CLIENT REVIEW	29/09/08
1.	ISSUED FOR PERMIT	25/09/08

PROJECT NAME:
West Pender Properties

Suite 230
830 West Pender Street
Vancouver, BC

DRAWING TITLE:
POWER, VOICE, & DATA PLAN

DATE:	29/09/08
SCALE:	1/4"=1'-0"
DRAWN BY:	DS
CHECKED BY:	MP
JOB NUMBER:	2008071

DRAWING NUMBER:
A4